

Note:

Non-detect results for dioxin-like PCB congeners and Aroclor mixtures were assigned values of ½ of the detection limit in the calculation of dioxin TEQ and total PCBs, respectively.


PRELIMINARY DRAFT

REGRESSION OF DIOXIN TEQ vs TOTAL PCBs
IN CONCRETE
Former Pechiney Cast Plate, Inc., Facility
3200 Fruitland Avenue
Vernon, California

By: TB/pah Date: 11/15/10 Project No. 10627.003

AMEC Geomatrix

Figure **3**

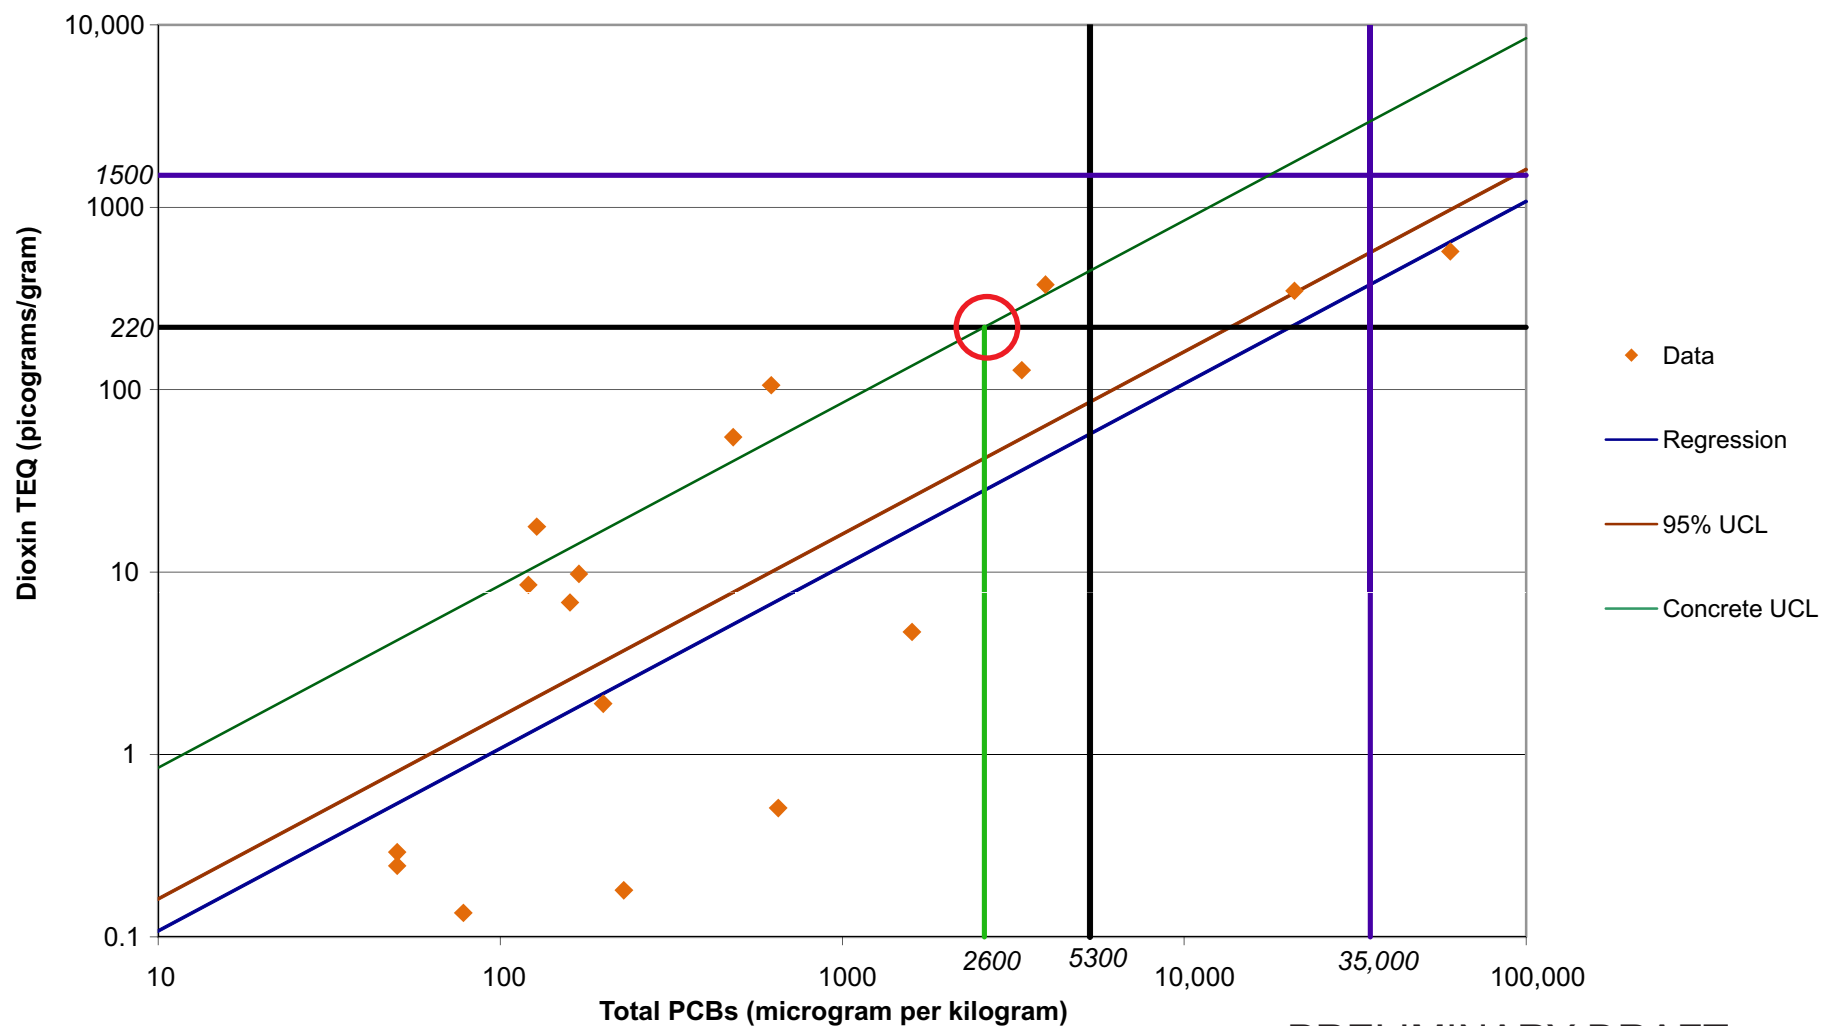

Note:

Non-detect results for dioxin-like PCB congeners and Aroclor mixtures were assigned values of $\frac{1}{2}$ of the detection limit in the calculation of dioxin TEQ and total PCBs, respectively.

PRELIMINARY DRAFT

REGRESSION OF DIOXIN TEQ vs TOTAL PCBs
IN SOIL
Former Pechiney Cast Plate, Inc., Facility
3200 Fruitland Avenue
Vernon, California

By: TB/pah Date: 11/16/10 Project No. 10627.003

AMEC Geomatrix

Figure **4**